



HFD

Risk Management


...

Creating a safety conscious environment

Expectations

- Fire Station compliance with national health & safety standards.
- Determine level of compliance of the four city fire stations with national fire protection association's safety and health standard.
- The national Fire Protection Association (NFPA) publishes standards for fire service. NFPA 1500 is a standard on the Fire Department Occupational Safety and Health Program.

Firefighter Injuries

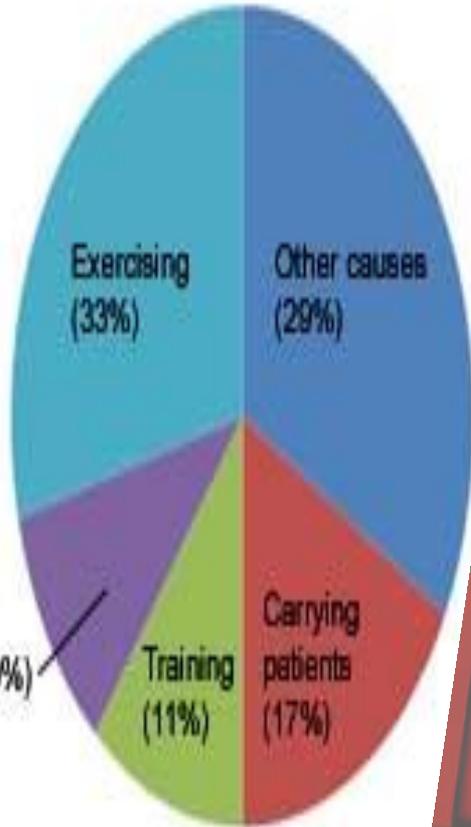

Statistics

- 12,535 injuries/annually on non-fire incidents.
- 7 fatalities/annually on non-fire incidents.
- Most injuries are caused by exercising and other causes. (Slipping, falling, jumping)
- 30 injuries/annually in Harrisonburg!



Managed inspections throughout the fire stations to help prevent any harmful environments for firefighters.

- Made sure that all utilities are located where they should be.
- Housekeeping
- Hazardous materials, electrical wiring, fixtures, and controls are following code.
- All working areas of station are hazardous free.
- Check building exterior & grounds.
- Suggested any ideas that stations should have.

Station #1

**80 Maryland Avenue Harrisonburg, VA
22801.**

- **First aid should be visible.**
- **Slip resistant mats in showers.**
- **Laundry room dirty.**
- **Head bump over firetrucks.**
- **Exhaust pipe caution.**
- **Weight room crowded.**

CAUTION



Station #2

380 Pleasant Valley Road Harrisonburg, VA 22801.

- Slip resistant mats in showers.
- Head bumps over firetrucks.
- First aid not visible.



Station #4

210 E Rock Street Harrisonburg, VA 22802 ..

- Slip resistant mats.
- Head bump over firetrucks. (Fan over trucks)



Conclusion

- Fire stations met NFPA standards.
- Learned the ways of conducting a fire station inspection
- Proposed idea to Paul about concerning issues
- Proposal to color rafters for renovation of fire station 1.

Questions?